



# Flex® Plug-Controlled Receptacle Devices - Title 24

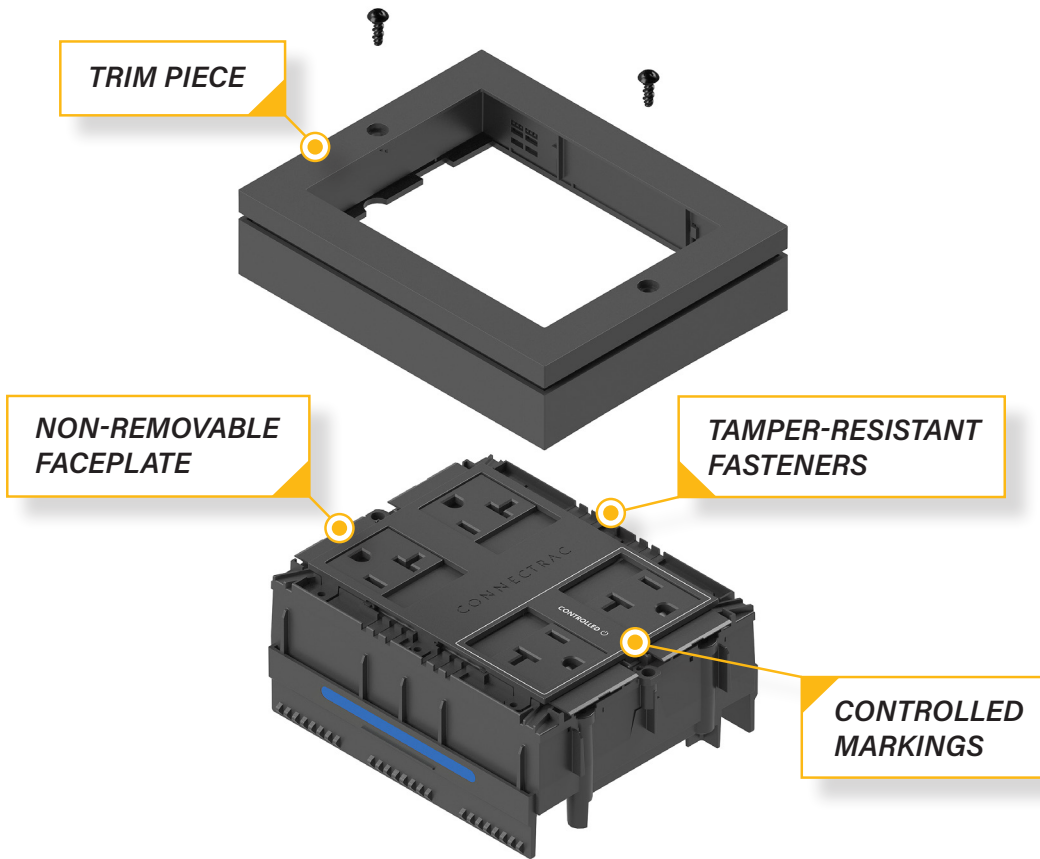

## NEC 406.3 - Receptacle Rating and Type

(E) Controlled Receptacle Marking. All nonlocking-type, 125-volt, 15- and 20-ampere receptacles that are controlled by an automatic control device, or that incorporate control features that remove power from the receptacle for the purpose of energy management or building automation, shall be permanently marked with the symbol shown in Figure 406.3(E)  and the word "controlled."

## Compliance

The permanent controlled markings are applied to the top surface of the receptacle, are fully visible after installation. The markings are applied during factory assembly and cannot be altered in the field with normal tools.

## Ordering Information



Part Number	Description
CT.C.PW1cc.1-Q12-DG	POWER DEVICE 1: TITLE 24 RECEPTACLE. 20A quad outlet. (2) circuit 1, (2) control ckt 2. DARK GRAY.
CT.C.PW1cc.1-Q14-DG	POWER DEVICE 1: TITLE 24 RECEPTACLE. 20A quad outlet. (2) circuit 1, (2) control ckt 4. DARK GRAY.
CT.C.PW1cc.1-Q34-DG	POWER DEVICE 1: TITLE 24 RECEPTACLE. 20A quad outlet. (2) circuit 3, (2) control ckt 4. DARK GRAY.